


Dimensions



If exposed set point adjustment knob used (scaled 18-25 C), then so that the sensor set point scale is in corrected calibration, the set point dial on the HTC controller must be set to 22 degrees. If the concealed knob is used which is scaled ± 3 then this adjustment will shift the HTC controllers setpoint by ± 3 degrees C. NOTE : Also fit supplied 78.7k resistor in parallel across temperature sensor terminals (to compensate for additional resistance of SPA adjuster produced in mid position).

CONNECTED THE SPA IN SERIES WITH EITHER OF THE TEMPERATURE SENSOR WIRES.

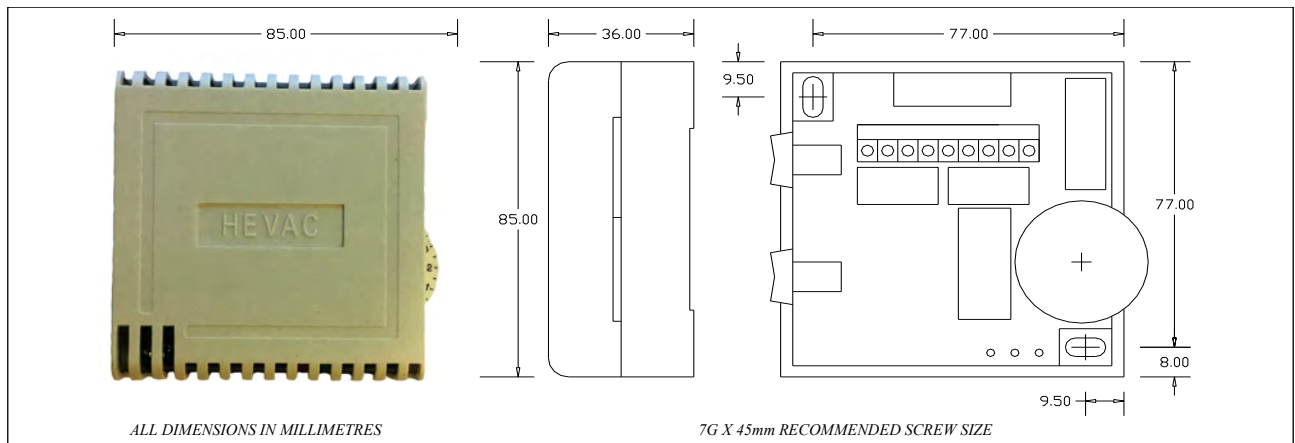